

Air Quality Monitoring Data

Project	Works	Date (yyyy-mm-dd)	Station	Time	Parameter	Results	Unit
HKLR	HY/2011/03	2014-03-05	AMS5	13:44	1-hr TSP	80	ug/m ³
HKLR	HY/2011/03	2014-03-05	AMS5	14:44	1-hr TSP	87	ug/m ³
HKLR	HY/2011/03	2014-03-05	AMS5	15:44	1-hr TSP	82	ug/m ³
HKLR	HY/2011/03	2014-03-11	AMS5	09:32	1-hr TSP	126	ug/m ³
HKLR	HY/2011/03	2014-03-11	AMS5	10:32	1-hr TSP	126	ug/m ³
HKLR	HY/2011/03	2014-03-11	AMS5	11:32	1-hr TSP	125	ug/m ³
HKLR	HY/2011/03	2014-03-17	AMS5	09:31	1-hr TSP	275	ug/m ³
HKLR	HY/2011/03	2014-03-17	AMS5	10:31	1-hr TSP	139	ug/m ³
HKLR	HY/2011/03	2014-03-17	AMS5	11:31	1-hr TSP	140	ug/m ³
HKLR	HY/2011/03	2014-03-21	AMS5	13:22	1-hr TSP	73	ug/m ³
HKLR	HY/2011/03	2014-03-21	AMS5	14:22	1-hr TSP	85	ug/m ³
HKLR	HY/2011/03	2014-03-21	AMS5	15:22	1-hr TSP	91	ug/m ³
HKLR	HY/2011/03	2014-03-27	AMS5	13:05	1-hr TSP	19	ug/m ³
HKLR	HY/2011/03	2014-03-27	AMS5	14:05	1-hr TSP	28	ug/m ³
HKLR	HY/2011/03	2014-03-27	AMS5	15:05	1-hr TSP	32	ug/m ³
HKLR	HY/2011/03	2014-04-02	AMS5	13:40	1-hr TSP	15	ug/m ³
HKLR	HY/2011/03	2014-04-02	AMS5	14:40	1-hr TSP	10	ug/m ³
HKLR	HY/2011/03	2014-04-02	AMS5	15:40	1-hr TSP	19	ug/m ³
HKLR	HY/2011/03	2014-04-08	AMS5	09:21	1-hr TSP	76	ug/m ³
HKLR	HY/2011/03	2014-04-08	AMS5	10:21	1-hr TSP	144	ug/m ³
HKLR	HY/2011/03	2014-04-08	AMS5	11:21	1-hr TSP	203	ug/m ³
HKLR	HY/2011/03	2014-04-14	AMS5	09:35	1-hr TSP	128	ug/m ³
HKLR	HY/2011/03	2014-04-14	AMS5	10:35	1-hr TSP	107	ug/m ³
HKLR	HY/2011/03	2014-04-14	AMS5	11:35	1-hr TSP	76	ug/m ³
HKLR	HY/2011/03	2014-04-17	AMS5	09:36	1-hr TSP	42	ug/m ³
HKLR	HY/2011/03	2014-04-17	AMS5	10:36	1-hr TSP	31	ug/m ³
HKLR	HY/2011/03	2014-04-17	AMS5	11:36	1-hr TSP	28	ug/m ³
HKLR	HY/2011/03	2014-04-23	AMS5	09:25	1-hr TSP	29	ug/m ³
HKLR	HY/2011/03	2014-04-23	AMS5	10:25	1-hr TSP	30	ug/m ³
HKLR	HY/2011/03	2014-04-23	AMS5	11:25	1-hr TSP	35	ug/m ³
HKLR	HY/2011/03	2014-04-29	AMS5	09:35	1-hr TSP	60	ug/m ³
HKLR	HY/2011/03	2014-04-29	AMS5	10:35	1-hr TSP	61	ug/m ³
HKLR	HY/2011/03	2014-04-29	AMS5	11:35	1-hr TSP	70	ug/m ³
HKLR	HY/2011/03	2014-05-05	AMS5	09:22	1-hr TSP	14	ug/m ³
HKLR	HY/2011/03	2014-05-05	AMS5	10:22	1-hr TSP	21	ug/m ³
HKLR	HY/2011/03	2014-05-05	AMS5	11:22	1-hr TSP	22	ug/m ³
HKLR	HY/2011/03	2014-05-09	AMS5	09:35	1-hr TSP	9	ug/m ³
HKLR	HY/2011/03	2014-05-09	AMS5	10:35	1-hr TSP	11	ug/m ³
HKLR	HY/2011/03	2014-05-09	AMS5	11:35	1-hr TSP	36	ug/m ³
HKLR	HY/2011/03	2014-05-15	AMS5	09:35	1-hr TSP	22	ug/m ³
HKLR	HY/2011/03	2014-05-15	AMS5	10:35	1-hr TSP	21	ug/m ³
HKLR	HY/2011/03	2014-05-15	AMS5	11:35	1-hr TSP	21	ug/m ³
HKLR	HY/2011/03	2014-05-21	AMS5	13:37	1-hr TSP	16	ug/m ³
HKLR	HY/2011/03	2014-05-21	AMS5	14:37	1-hr TSP	15	ug/m ³
HKLR	HY/2011/03	2014-05-21	AMS5	15:37	1-hr TSP	15	ug/m ³
HKLR	HY/2011/03	2014-05-27	AMS5	09:32	1-hr TSP	17	ug/m ³
HKLR	HY/2011/03	2014-05-27	AMS5	10:32	1-hr TSP	25	ug/m ³
HKLR	HY/2011/03	2014-05-27	AMS5	11:32	1-hr TSP	19	ug/m ³
HKLR	HY/2011/03	2014-03-04	AMS5	08:00	24-hr TSP	124	ug/m ³
HKLR	HY/2011/03	2014-03-10	AMS5	08:00	24-hr TSP	65	ug/m ³
HKLR	HY/2011/03	2014-03-14	AMS5	08:00	24-hr TSP	115	ug/m ³
HKLR	HY/2011/03	2014-03-20	AMS5	08:00	24-hr TSP	136	ug/m ³
HKLR	HY/2011/03	2014-03-26	AMS5	08:00	24-hr TSP	47	ug/m ³
HKLR	HY/2011/03	2014-04-01	AMS5	08:00	24-hr TSP	73	ug/m ³
HKLR	HY/2011/03	2014-04-07	AMS5	08:00	24-hr TSP	52	ug/m ³

Air Quality Monitoring Data

Project	Works	Date (yyyy-mm-dd)	Station	Time	Parameter	Results	Unit
HKLR	HY/2011/03	2014-04-11	AMS5	08:00	24-hr TSP	51	ug/m ³
HKLR	HY/2011/03	2014-04-16	AMS5	08:00	24-hr TSP	58	ug/m ³
HKLR	HY/2011/03	2014-04-22	AMS5	08:00	24-hr TSP	60	ug/m ³
HKLR	HY/2011/03	2014-04-28	AMS5	08:00	24-hr TSP	86	ug/m ³
HKLR	HY/2011/03	2014-05-02	AMS5	08:00	24-hr TSP	35	ug/m ³
HKLR	HY/2011/03	2014-05-08	AMS5	08:00	24-hr TSP	20	ug/m ³
HKLR	HY/2011/03	2014-05-14	AMS5	08:00	24-hr TSP	30	ug/m ³
HKLR	HY/2011/03	2014-05-20	AMS5	08:00	24-hr TSP	30	ug/m ³
HKLR	HY/2011/03	2014-05-26	AMS5	08:00	24-hr TSP	21	ug/m ³
HKLR	HY/2011/03	2014-05-30	AMS5	08:00	24-hr TSP	19	ug/m ³
HKLR	HY/2011/03	2014-03-05	AMS6	08:14	1-hr TSP	22	ug/m ³
HKLR	HY/2011/03	2014-03-05	AMS6	09:14	1-hr TSP	30	ug/m ³
HKLR	HY/2011/03	2014-03-05	AMS6	10:14	1-hr TSP	47	ug/m ³
HKLR	HY/2011/03	2014-03-11	AMS6	13:31	1-hr TSP	136	ug/m ³
HKLR	HY/2011/03	2014-03-11	AMS6	14:31	1-hr TSP	144	ug/m ³
HKLR	HY/2011/03	2014-03-11	AMS6	15:31	1-hr TSP	132	ug/m ³
HKLR	HY/2011/03	2014-03-17	AMS6	13:21	1-hr TSP	77	ug/m ³
HKLR	HY/2011/03	2014-03-17	AMS6	14:21	1-hr TSP	70	ug/m ³
HKLR	HY/2011/03	2014-03-17	AMS6	15:21	1-hr TSP	60	ug/m ³
HKLR	HY/2011/03	2014-03-21	AMS6	09:33	1-hr TSP	66	ug/m ³
HKLR	HY/2011/03	2014-03-21	AMS6	10:33	1-hr TSP	73	ug/m ³
HKLR	HY/2011/03	2014-03-21	AMS6	11:33	1-hr TSP	72	ug/m ³
HKLR	HY/2011/03	2014-03-27	AMS6	09:00	1-hr TSP	39	ug/m ³
HKLR	HY/2011/03	2014-03-27	AMS6	10:00	1-hr TSP	33	ug/m ³
HKLR	HY/2011/03	2014-03-27	AMS6	11:00	1-hr TSP	21	ug/m ³
HKLR	HY/2011/03	2014-04-02	AMS6	08:31	1-hr TSP	30	ug/m ³
HKLR	HY/2011/03	2014-04-02	AMS6	09:31	1-hr TSP	16	ug/m ³
HKLR	HY/2011/03	2014-04-02	AMS6	10:31	1-hr TSP	16	ug/m ³
HKLR	HY/2011/03	2014-04-08	AMS6	13:37	1-hr TSP	22	ug/m ³
HKLR	HY/2011/03	2014-04-08	AMS6	14:37	1-hr TSP	27	ug/m ³
HKLR	HY/2011/03	2014-04-08	AMS6	15:37	1-hr TSP	20	ug/m ³
HKLR	HY/2011/03	2014-04-14	AMS6	13:35	1-hr TSP	49	ug/m ³
HKLR	HY/2011/03	2014-04-14	AMS6	14:35	1-hr TSP	43	ug/m ³
HKLR	HY/2011/03	2014-04-14	AMS6	15:35	1-hr TSP	41	ug/m ³
HKLR	HY/2011/03	2014-04-17	AMS6	13:31	1-hr TSP	25	ug/m ³
HKLR	HY/2011/03	2014-04-17	AMS6	14:31	1-hr TSP	30	ug/m ³
HKLR	HY/2011/03	2014-04-17	AMS6	15:31	1-hr TSP	34	ug/m ³
HKLR	HY/2011/03	2014-04-23	AMS6	13:35	1-hr TSP	71	ug/m ³
HKLR	HY/2011/03	2014-04-23	AMS6	14:35	1-hr TSP	112	ug/m ³
HKLR	HY/2011/03	2014-04-23	AMS6	15:35	1-hr TSP	118	ug/m ³
HKLR	HY/2011/03	2014-04-29	AMS6	13:22	1-hr TSP	52	ug/m ³
HKLR	HY/2011/03	2014-04-29	AMS6	14:22	1-hr TSP	56	ug/m ³
HKLR	HY/2011/03	2014-04-29	AMS6	15:22	1-hr TSP	60	ug/m ³
HKLR	HY/2011/03	2014-05-05	AMS6	13:17	1-hr TSP	22	ug/m ³
HKLR	HY/2011/03	2014-05-05	AMS6	14:17	1-hr TSP	24	ug/m ³
HKLR	HY/2011/03	2014-05-05	AMS6	15:17	1-hr TSP	32	ug/m ³
HKLR	HY/2011/03	2014-05-09	AMS6	13:28	1-hr TSP	18	ug/m ³
HKLR	HY/2011/03	2014-05-09	AMS6	14:28	1-hr TSP	18	ug/m ³
HKLR	HY/2011/03	2014-05-09	AMS6	15:28	1-hr TSP	22	ug/m ³
HKLR	HY/2011/03	2014-05-15	AMS6	13:28	1-hr TSP	19	ug/m ³
HKLR	HY/2011/03	2014-05-15	AMS6	14:28	1-hr TSP	17	ug/m ³
HKLR	HY/2011/03	2014-05-15	AMS6	15:28	1-hr TSP	18	ug/m ³
HKLR	HY/2011/03	2014-05-21	AMS6	08:15	1-hr TSP	16	ug/m ³
HKLR	HY/2011/03	2014-05-21	AMS6	09:15	1-hr TSP	15	ug/m ³
HKLR	HY/2011/03	2014-05-21	AMS6	10:15	1-hr TSP	15	ug/m ³


Air Quality Monitoring Data

Project	Works	Date (yyyy-mm-dd)	Station	Time	Parameter	Results	Unit
HKLR	HY/2011/03	2014-05-27	AMS6	13:33	1-hr TSP	25	ug/m ³
HKLR	HY/2011/03	2014-05-27	AMS6	14:33	1-hr TSP	28	ug/m ³
HKLR	HY/2011/03	2014-05-27	AMS6	15:33	1-hr TSP	32	ug/m ³
HKLR	HY/2011/03	2014-03-04	AMS6	08:00	24-hr TSP	128	ug/m ³
HKLR	HY/2011/03	2014-03-10	AMS6	08:00	24-hr TSP	74	ug/m ³
HKLR	HY/2011/03	2014-03-14	AMS6	08:00	24-hr TSP	124	ug/m ³
HKLR	HY/2011/03	2014-03-20	AMS6	08:00	24-hr TSP	190	ug/m ³
HKLR	HY/2011/03	2014-03-26	AMS6	08:00	24-hr TSP	87	ug/m ³
HKLR	HY/2011/03	2014-04-01	AMS6	08:00	24-hr TSP	56	ug/m ³
HKLR	HY/2011/03	2014-04-07	AMS6	08:00	24-hr TSP	(VOID)	ug/m ³
HKLR	HY/2011/03	2014-04-14	AMS6	14:22	24-hr TSP	81	ug/m ³
HKLR	HY/2011/03	2014-04-15	AMS6	14:45	24-hr TSP	73	ug/m ³
HKLR	HY/2011/03	2014-04-16	AMS6	14:58	24-hr TSP	76	ug/m ³
HKLR	HY/2011/03	2014-04-22	AMS6	08:00	24-hr TSP	69	ug/m ³
HKLR	HY/2011/03	2014-04-28	AMS6	08:00	24-hr TSP	158	ug/m ³
HKLR	HY/2011/03	2014-05-02	AMS6	08:00	24-hr TSP	61	ug/m ³
HKLR	HY/2011/03	2014-05-08	AMS6	08:00	24-hr TSP	28	ug/m ³
HKLR	HY/2011/03	2014-05-14	AMS6	08:00	24-hr TSP	31	ug/m ³
HKLR	HY/2011/03	2014-05-20	AMS6	08:00	24-hr TSP	29	ug/m ³
HKLR	HY/2011/03	2014-05-26	AMS6	08:00	24-hr TSP	39	ug/m ³
HKLR	HY/2011/03	2014-05-30	AMS6	08:00	24-hr TSP	86	ug/m ³


Remark

1) The motor of high volume sampler (HVS) was malfunction on 7 April 2014 at AMS6. There was a problem with power supply to the HVS on 11 April 2014 at AMS6. Therefore, original dust monitoring on 7 and 11 April 2014 was rescheduled on 14 and 15 April 2014.

Graphical Plot of 1-hour TSP at AMS5 and AMS6

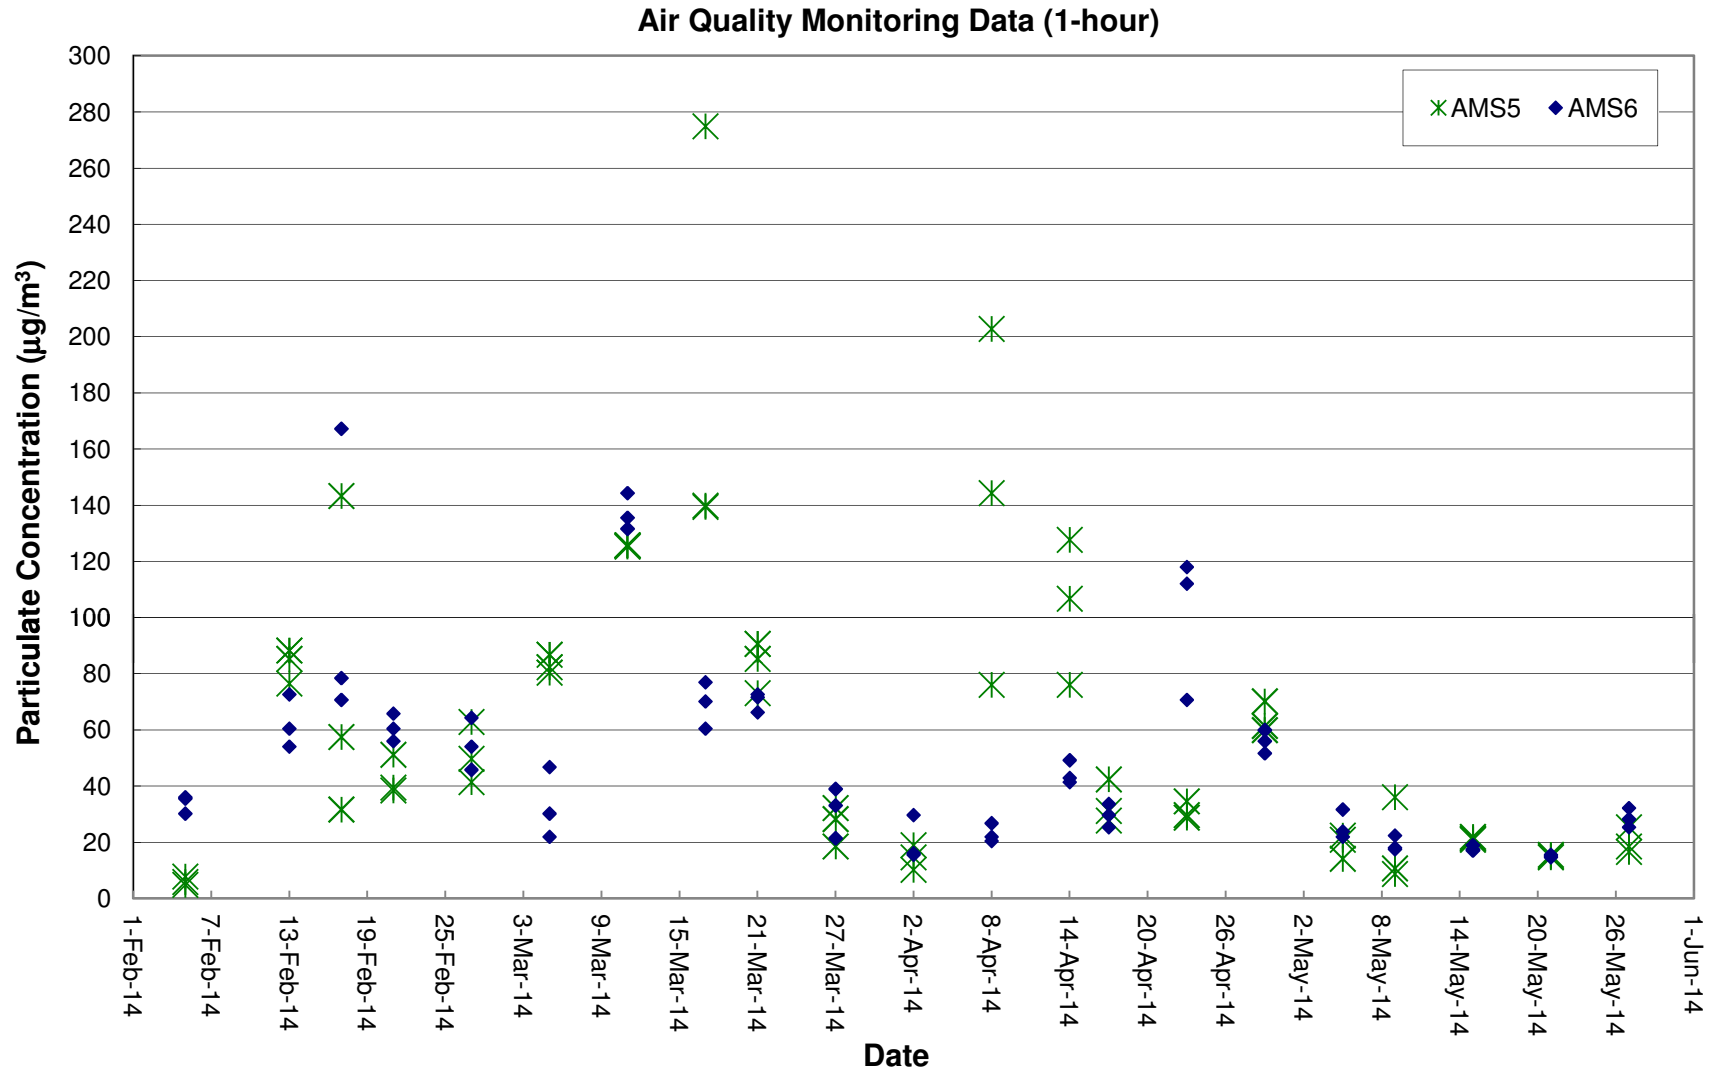

Graphical Plot of 24-hour TSP at AMS5 and AMS6

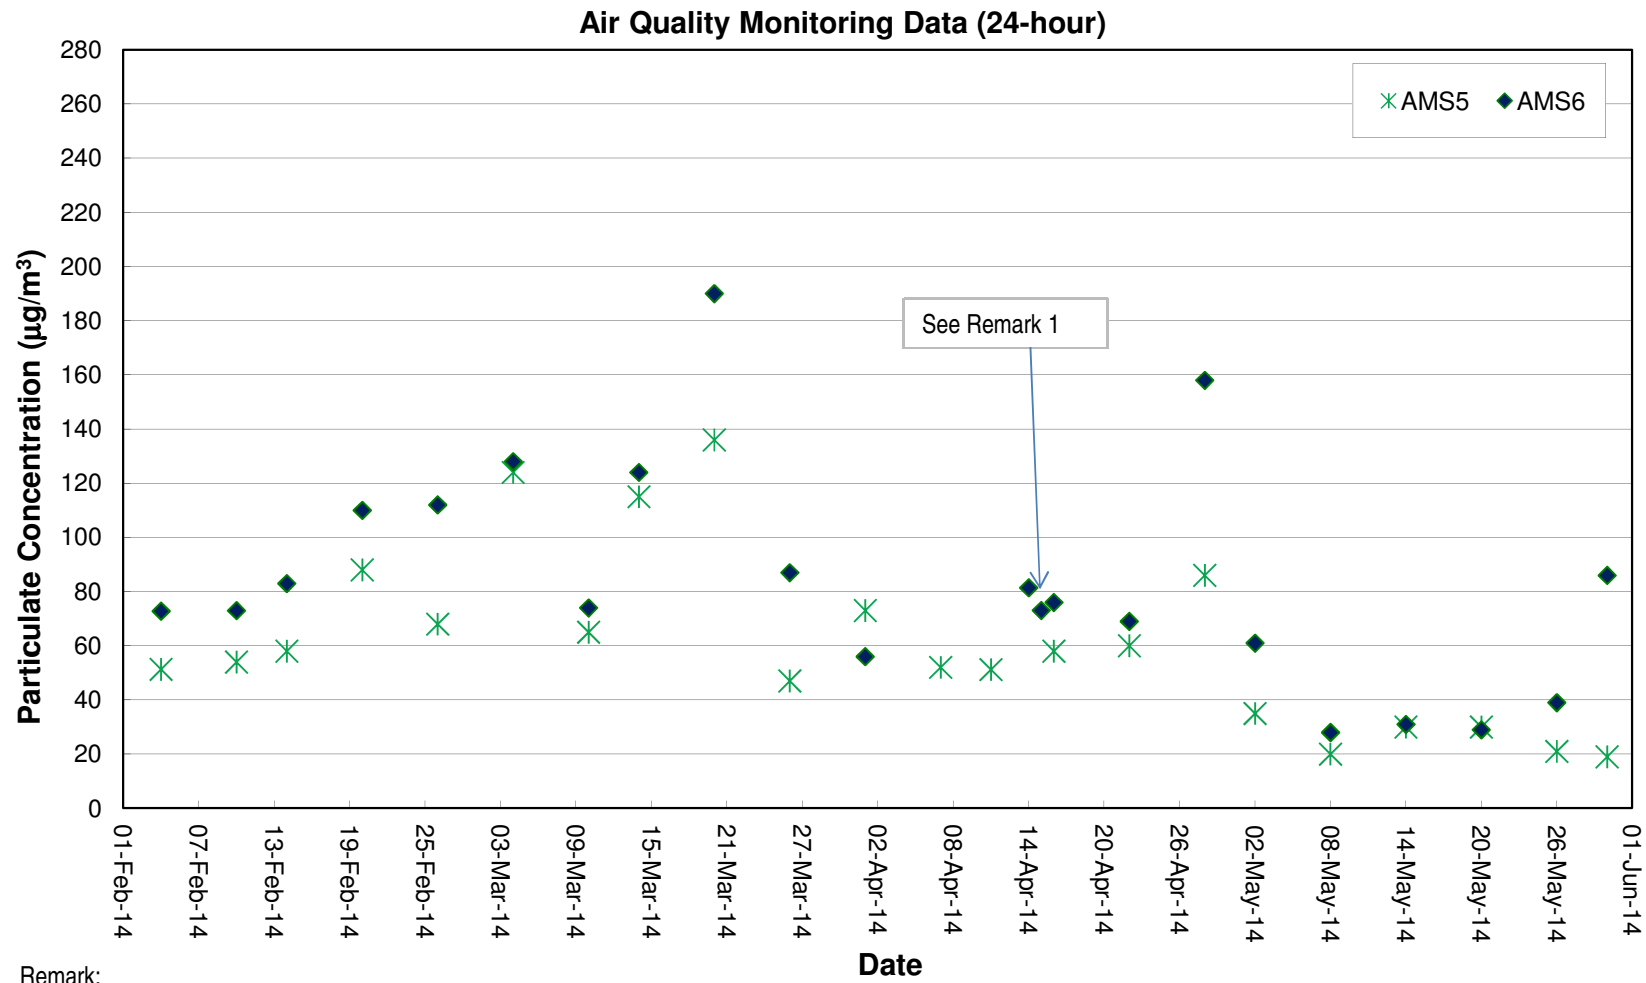

Remark:

1) The motor of high volume sampler (HVS) was malfunction at AMS6 on 7 April 2014. There was a problem with power supply for the HVS at AMS6 on 11 April 2014. Therefore, the dust monitoring on 7 and 11 April 2014 was rescheduled for 14 and 15 April 2014.