

**Air Quality Monitoring Data**

Project	Works	Date (yyyy-mm-dd)	Station	Time	Parameter	Results	Unit
HKLR	HY/2011/03	2018-06-04	AMS5	09:10	1-hr TSP	30	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-04	AMS5	10:10	1-hr TSP	32	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-04	AMS5	11:10	1-hr TSP	34	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-08	AMS5	13:00	1-hr TSP	19	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-08	AMS5	14:00	1-hr TSP	19	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-08	AMS5	15:00	1-hr TSP	25	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-14	AMS5	09:00	1-hr TSP	54	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-14	AMS5	10:00	1-hr TSP	73	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-14	AMS5	11:00	1-hr TSP	74	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-20	AMS5	09:00	1-hr TSP	16	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-20	AMS5	10:00	1-hr TSP	14	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-20	AMS5	11:00	1-hr TSP	14	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-26	AMS5	09:00	1-hr TSP	7	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-26	AMS5	10:00	1-hr TSP	6	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-26	AMS5	11:00	1-hr TSP	7	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-28	AMS5	09:00	1-hr TSP	9	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-28	AMS5	10:00	1-hr TSP	8	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-28	AMS5	11:00	1-hr TSP	10	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-01	AMS5	08:00	24-hr TSP	39	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-07	AMS5	08:00	24-hr TSP	18	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-13	AMS5	08:00	24-hr TSP	55	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-19	AMS5	08:00	24-hr TSP	37	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-25	AMS5	08:00	24-hr TSP	25	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-27	AMS5	11:54	24-hr TSP	25	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-04	AMS6	13:00	1-hr TSP	33	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-04	AMS6	14:00	1-hr TSP	30	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-04	AMS6	15:00	1-hr TSP	30	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-08	AMS6	09:10	1-hr TSP	14	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-08	AMS6	10:10	1-hr TSP	16	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-08	AMS6	11:10	1-hr TSP	16	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-14	AMS6	13:00	1-hr TSP	57	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-14	AMS6	14:00	1-hr TSP	54	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-14	AMS6	15:00	1-hr TSP	49	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-20	AMS6	13:00	1-hr TSP	20	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-20	AMS6	14:00	1-hr TSP	20	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-20	AMS6	15:00	1-hr TSP	18	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-26	AMS6	13:18	1-hr TSP	24	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-26	AMS6	14:18	1-hr TSP	17	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-26	AMS6	15:18	1-hr TSP	16	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-28	AMS6	13:00	1-hr TSP	22	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-28	AMS6	14:00	1-hr TSP	23	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-28	AMS6	15:00	1-hr TSP	21	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-01	AMS6	08:00	24-hr TSP	382	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-07	AMS6	17:28	24-hr TSP	32	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-13	AMS6	08:00	24-hr TSP	71	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-19	AMS6	08:00	24-hr TSP	120	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-25	AMS6	08:00	24-hr TSP	33	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-06-27	AMS6	12:20	24-hr TSP	58	µg/m <sup>3</sup>

**Air Quality Monitoring Data**

Project	Works	Date (yyyy-mm-dd)	Station	Time	Parameter	Results	Unit
HKLR	HY/2011/03	2018-07-04	AMS5	09:00	1-hr TSP	6	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-04	AMS5	10:00	1-hr TSP	6	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-04	AMS5	11:00	1-hr TSP	6	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-10	AMS5	09:00	1-hr TSP	18	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-10	AMS5	10:00	1-hr TSP	8	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-10	AMS5	11:00	1-hr TSP	4	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-16	AMS5	09:00	1-hr TSP	12	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-16	AMS5	10:00	1-hr TSP	11	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-16	AMS5	11:00	1-hr TSP	13	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-20	AMS5	09:00	1-hr TSP	5	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-20	AMS5	10:00	1-hr TSP	7	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-20	AMS5	11:00	1-hr TSP	6	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-26	AMS5	09:00	1-hr TSP	12	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-26	AMS5	10:00	1-hr TSP	15	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-26	AMS5	11:00	1-hr TSP	11	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-03	AMS5	08:00	24-hr TSP	34	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-09	AMS5	08:00	24-hr TSP	24	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-13	AMS5	08:00	24-hr TSP	22	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-19	AMS5	08:00	24-hr TSP	19	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-25	AMS5	08:00	24-hr TSP	40	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-31	AMS5	08:00	24-hr TSP	See Remark 1	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-04	AMS6	13:00	1-hr TSP	14	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-04	AMS6	14:00	1-hr TSP	16	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-04	AMS6	15:00	1-hr TSP	15	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-10	AMS6	13:00	1-hr TSP	10	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-10	AMS6	14:00	1-hr TSP	11	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-10	AMS6	15:00	1-hr TSP	14	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-16	AMS6	13:00	1-hr TSP	14	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-16	AMS6	14:00	1-hr TSP	13	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-16	AMS6	15:00	1-hr TSP	13	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-20	AMS6	13:00	1-hr TSP	6	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-20	AMS6	14:00	1-hr TSP	9	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-20	AMS6	15:00	1-hr TSP	10	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-26	AMS6	13:00	1-hr TSP	12	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-26	AMS6	14:00	1-hr TSP	10	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-26	AMS6	15:00	1-hr TSP	11	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-03	AMS6	08:00	24-hr TSP	48	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-09	AMS6	08:00	24-hr TSP	51	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-13	AMS6	08:00	24-hr TSP	22	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-19	AMS6	08:00	24-hr TSP	17	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-25	AMS6	08:00	24-hr TSP	48	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-07-31	AMS6	08:00	24-hr TSP	99	µg/m <sup>3</sup>

Remark:

1) The monitoring time for TSP monitoring on 31 July 2018 at AMS5 (Ma Wan Chung Village) was less than 24-hr due to power interruption of the high volume sampler (HVS). The 24-hr TSP monitoring was rescheduled from 31 July 2018 to 1 August 2018.


## Air Quality Monitoring Data

Project	Works	Date (yyyy-mm-dd)	Station	Time	Parameter	Results	Unit
HKLR	HY/2011/03	2018-08-01	AMS5	09:00	1-hr TSP	7	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-01	AMS5	10:00	1-hr TSP	5	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-01	AMS5	11:00	1-hr TSP	5	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-07	AMS5	09:00	1-hr TSP	10	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-07	AMS5	10:00	1-hr TSP	8	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-07	AMS5	11:00	1-hr TSP	9	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-13	AMS5	09:00	1-hr TSP	11	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-13	AMS5	10:00	1-hr TSP	10	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-13	AMS5	11:00	1-hr TSP	10	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-17	AMS5	09:09	1-hr TSP	22	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-17	AMS5	10:09	1-hr TSP	19	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-17	AMS5	11:09	1-hr TSP	18	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-23	AMS5	09:03	1-hr TSP	31	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-23	AMS5	10:03	1-hr TSP	61	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-23	AMS5	11:03	1-hr TSP	41	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-29	AMS5	09:01	1-hr TSP	7	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-29	AMS5	10:01	1-hr TSP	7	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-29	AMS5	11:01	1-hr TSP	11	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-01	AMS5	11:15	24-hr TSP	26 (See Remark 1)	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-08	AMS5	11:16	24-hr TSP	22 (See Remark 2)	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-10	AMS5	08:00	24-hr TSP	17	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-16	AMS5	08:00	24-hr TSP	19	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-22	AMS5	08:00	24-hr TSP	38	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-28	AMS5	08:00	24-hr TSP	22	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-01	AMS6	13:00	1-hr TSP	12	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-01	AMS6	14:00	1-hr TSP	9	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-01	AMS6	15:00	1-hr TSP	15	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-07	AMS6	13:00	1-hr TSP	9	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-07	AMS6	14:00	1-hr TSP	17	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-07	AMS6	15:00	1-hr TSP	19	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-13	AMS6	13:00	1-hr TSP	7	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-13	AMS6	14:00	1-hr TSP	7	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-13	AMS6	15:00	1-hr TSP	8	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-17	AMS6	13:42	1-hr TSP	9	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-17	AMS6	14:42	1-hr TSP	5	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-17	AMS6	15:42	1-hr TSP	7	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-23	AMS6	13:03	1-hr TSP	69	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-23	AMS6	14:03	1-hr TSP	90	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-23	AMS6	15:03	1-hr TSP	86	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-29	AMS6	13:15	1-hr TSP	18	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-29	AMS6	14:15	1-hr TSP	18	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-29	AMS6	15:15	1-hr TSP	27	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-06	AMS6	08:00	24-hr TSP	74	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-10	AMS6	08:00	24-hr TSP	23	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-16	AMS6	08:00	24-hr TSP	20	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-22	AMS6	08:00	24-hr TSP	47	µg/m <sup>3</sup>
HKLR	HY/2011/03	2018-08-28	AMS6	08:00	24-hr TSP	29	µg/m <sup>3</sup>

### Remarks:


- 1) The monitoring time for TSP monitoring on 31 July 2018 at AMS5 (Ma Wan Chung Village) was less than 24-hr due to power interruption of the high volume sampler (HVS). The 24-hr TSP monitoring was rescheduled from 31 July 2018 to 1 August 2018.
- 2) The monitoring time for TSP monitoring on 6 August 2018 at AMS5 (Ma Wan Chung Village) was less than 24-hr due to malfunction of HVS. The 24-hr TSP monitoring was rescheduled from 6 August 2018 to 8 August 2018.

# Air Quality Monitoring Data (1-hour)

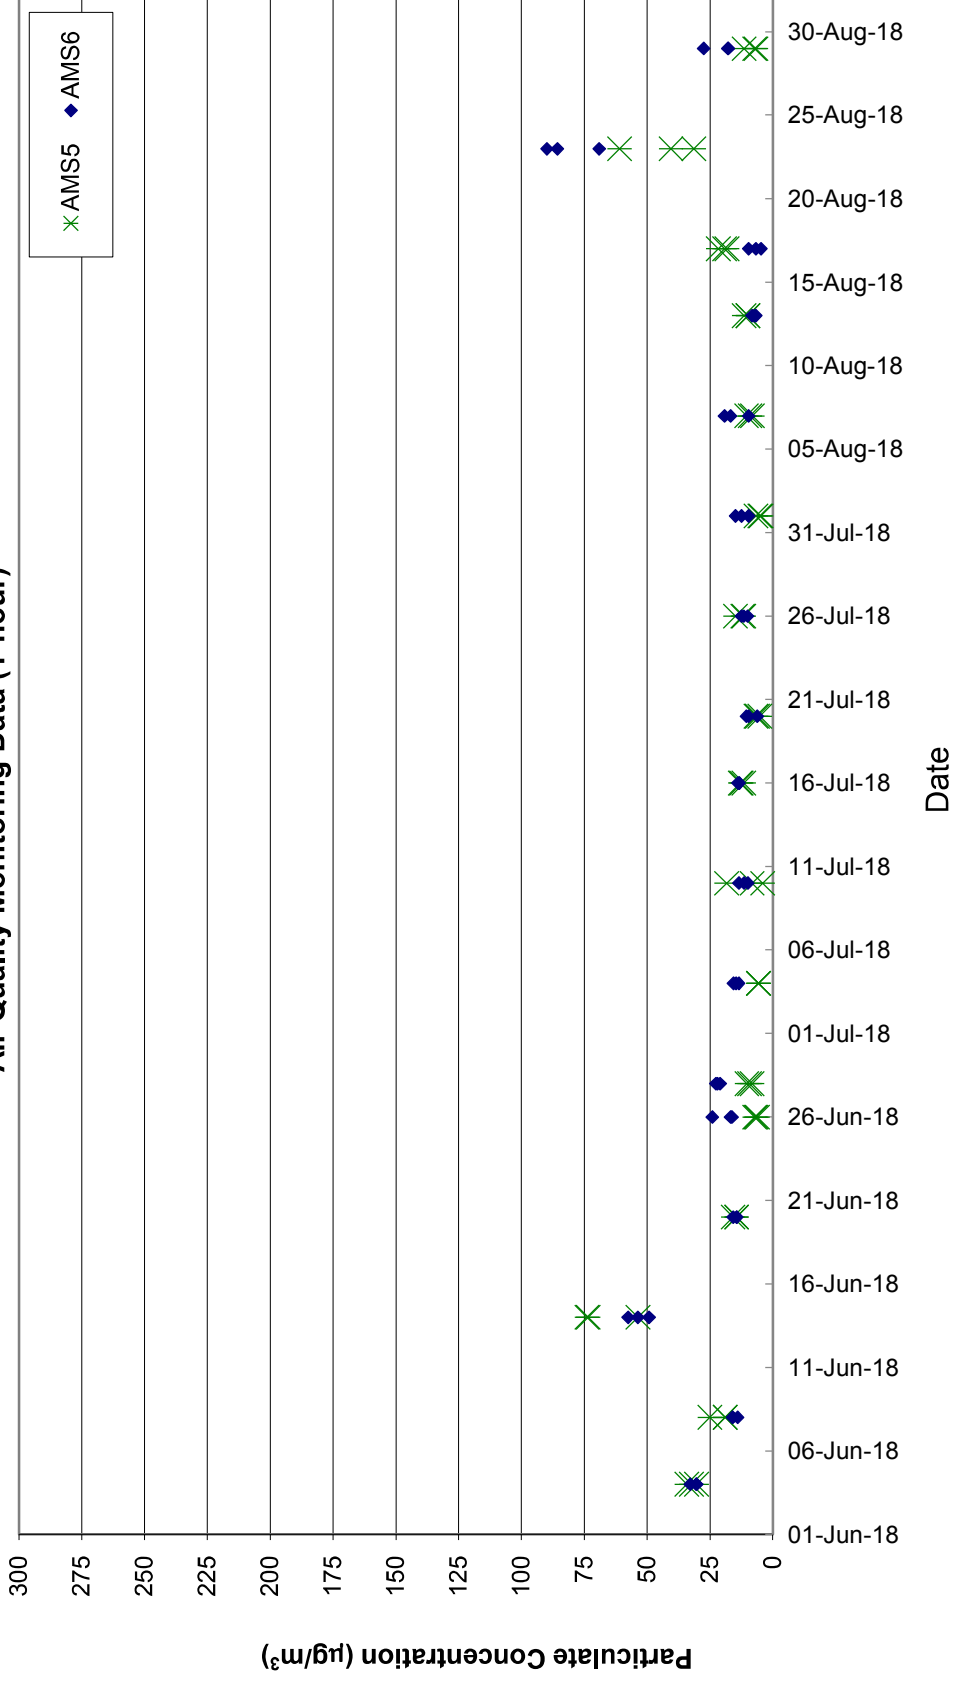

Graphical Plot of 24-hour TSP at AMS5 and AMS6

Air Quality Monitoring Data (24-hour)

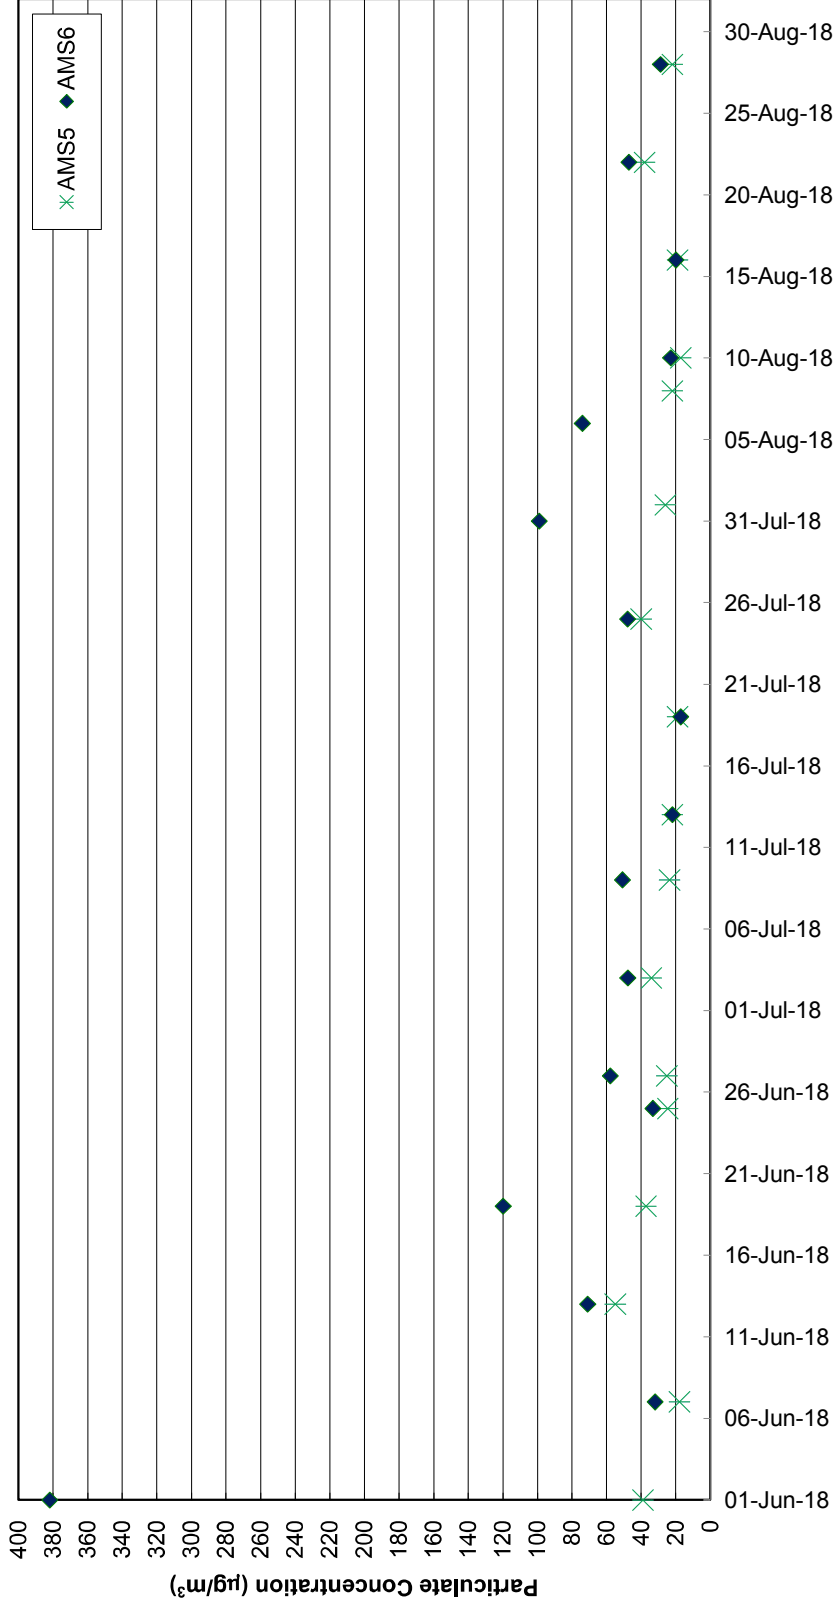

Remarks:

- 1) Due to power interruption of the High Volume Sampler, the 24-hr TSP monitoring on 31 July 2018 at Ma Wan Chung Village (AMS5) was rescheduled from 31 July 2018 to 1 August 2018.
- 2) The monitoring time for TSP monitoring on 6 August 2018 at AMS5 (Ma Wan Chung Village) was less than 24-hr due to malfunction of HVS. The 24-hr TSP monitoring was rescheduled from 6 August 2018 to 8 August 2018.