

Air Quality Monitoring Data

Project	Works	Date (yyyy-mm-dd)	Station	Time	Parameter	Results	Unit
HKLR	HY/2011/03	2017-06-01	AMS5	08:14	1-hr TSP	18	ug/m ³
HKLR	HY/2011/03	2017-06-01	AMS5	09:14	1-hr TSP	16	ug/m ³
HKLR	HY/2011/03	2017-06-01	AMS5	10:14	1-hr TSP	16	ug/m ³
HKLR	HY/2011/03	2017-06-07	AMS5	08:10	1-hr TSP	12	ug/m ³
HKLR	HY/2011/03	2017-06-07	AMS5	09:10	1-hr TSP	20	ug/m ³
HKLR	HY/2011/03	2017-06-07	AMS5	10:10	1-hr TSP	12	ug/m ³
HKLR	HY/2011/03	2017-06-13	AMS5	09:01	1-hr TSP	15	ug/m ³
HKLR	HY/2011/03	2017-06-13	AMS5	10:01	1-hr TSP	28	ug/m ³
HKLR	HY/2011/03	2017-06-13	AMS5	11:01	1-hr TSP	12	ug/m ³
HKLR	HY/2011/03	2017-06-19	AMS5	09:05	1-hr TSP	27	ug/m ³
HKLR	HY/2011/03	2017-06-19	AMS5	10:05	1-hr TSP	17	ug/m ³
HKLR	HY/2011/03	2017-06-19	AMS5	11:05	1-hr TSP	12	ug/m ³
HKLR	HY/2011/03	2017-06-23	AMS5	13:00	1-hr TSP	12	ug/m ³
HKLR	HY/2011/03	2017-06-23	AMS5	14:00	1-hr TSP	9	ug/m ³
HKLR	HY/2011/03	2017-06-23	AMS5	15:00	1-hr TSP	8	ug/m ³
HKLR	HY/2011/03	2017-06-29	AMS5	09:00	1-hr TSP	36	ug/m ³
HKLR	HY/2011/03	2017-06-29	AMS5	10:00	1-hr TSP	9	ug/m ³
HKLR	HY/2011/03	2017-06-29	AMS5	11:00	1-hr TSP	11	ug/m ³
HKLR	HY/2011/03	2017-07-03	AMS5	09:00	1-hr TSP	8	ug/m ³
HKLR	HY/2011/03	2017-07-03	AMS5	10:00	1-hr TSP	18	ug/m ³
HKLR	HY/2011/03	2017-07-03	AMS5	11:00	1-hr TSP	28	ug/m ³
HKLR	HY/2011/03	2017-07-07	AMS5	13:00	1-hr TSP	5	ug/m ³
HKLR	HY/2011/03	2017-07-07	AMS5	14:00	1-hr TSP	3	ug/m ³
HKLR	HY/2011/03	2017-07-07	AMS5	15:00	1-hr TSP	8	ug/m ³
HKLR	HY/2011/03	2017-07-13	AMS5	09:00	1-hr TSP	7	ug/m ³
HKLR	HY/2011/03	2017-07-13	AMS5	10:00	1-hr TSP	8	ug/m ³
HKLR	HY/2011/03	2017-07-13	AMS5	11:00	1-hr TSP	11	ug/m ³
HKLR	HY/2011/03	2017-07-19	AMS5	09:03	1-hr TSP	11	ug/m ³
HKLR	HY/2011/03	2017-07-19	AMS5	10:03	1-hr TSP	9	ug/m ³
HKLR	HY/2011/03	2017-07-19	AMS5	11:03	1-hr TSP	8	ug/m ³
HKLR	HY/2011/03	2017-07-25	AMS5	08:50	1-hr TSP	7	ug/m ³
HKLR	HY/2011/03	2017-07-25	AMS5	09:50	1-hr TSP	5	ug/m ³
HKLR	HY/2011/03	2017-07-25	AMS5	10:50	1-hr TSP	3	ug/m ³
HKLR	HY/2011/03	2017-07-31	AMS5	09:00	1-hr TSP	97	ug/m ³
HKLR	HY/2011/03	2017-07-31	AMS5	10:00	1-hr TSP	92	ug/m ³
HKLR	HY/2011/03	2017-07-31	AMS5	11:00	1-hr TSP	94	ug/m ³
HKLR	HY/2011/03	2017-08-04	AMS5	13:00	1-hr TSP	22	ug/m ³
HKLR	HY/2011/03	2017-08-04	AMS5	14:00	1-hr TSP	27	ug/m ³
HKLR	HY/2011/03	2017-08-04	AMS5	15:00	1-hr TSP	22	ug/m ³
HKLR	HY/2011/03	2017-08-10	AMS5	09:00	1-hr TSP	36	ug/m ³
HKLR	HY/2011/03	2017-08-10	AMS5	10:00	1-hr TSP	13	ug/m ³
HKLR	HY/2011/03	2017-08-10	AMS5	11:00	1-hr TSP	12	ug/m ³
HKLR	HY/2011/03	2017-08-16	AMS5	09:00	1-hr TSP	16	ug/m ³
HKLR	HY/2011/03	2017-08-16	AMS5	10:00	1-hr TSP	18	ug/m ³
HKLR	HY/2011/03	2017-08-16	AMS5	11:00	1-hr TSP	18	ug/m ³
HKLR	HY/2011/03	2017-08-22	AMS5	08:57	1-hr TSP	112	ug/m ³
HKLR	HY/2011/03	2017-08-22	AMS5	09:57	1-hr TSP	146	ug/m ³
HKLR	HY/2011/03	2017-08-22	AMS5	10:57	1-hr TSP	200	ug/m ³
HKLR	HY/2011/03	2017-08-28	AMS5	13:00	1-hr TSP	12	ug/m ³
HKLR	HY/2011/03	2017-08-28	AMS5	14:00	1-hr TSP	10	ug/m ³
HKLR	HY/2011/03	2017-08-28	AMS5	15:00	1-hr TSP	12	ug/m ³
HKLR	HY/2011/03	2017-06-06	AMS5	08:00	24-hr TSP	33	ug/m ³
HKLR	HY/2011/03	2017-06-12	AMS5	08:00	24-hr TSP	33	ug/m ³

Air Quality Monitoring Data

HKLR	HY/2011/03	2017-06-17	AMS5	08:00	24-hr TSP	37	ug/m ³
HKLR	HY/2011/03	2017-06-22	AMS5	08:00	24-hr TSP	39	ug/m ³
HKLR	HY/2011/03	2017-06-29 (See Remark 1)	AMS5	09:40	24-hr TSP	30	ug/m ³
HKLR	HY/2011/03	2017-07-04	AMS5	08:00	24-hr TSP	43	ug/m ³
HKLR	HY/2011/03	2017-07-06	AMS5	08:00	24-hr TSP	28	ug/m ³
HKLR	HY/2011/03	2017-07-12	AMS5	08:00	24-hr TSP	48	ug/m ³
HKLR	HY/2011/03	2017-07-18	AMS5	08:00	24-hr TSP	39	ug/m ³
HKLR	HY/2011/03	2017-07-26 (See Remark 2)	AMS5	12:25	24-hr TSP	54	ug/m ³
HKLR	HY/2011/03	2017-07-28	AMS5	10:50	24-hr TSP	53	ug/m ³
HKLR	HY/2011/03	2017-08-03	AMS5	08:00	24-hr TSP	25	ug/m ³
HKLR	HY/2011/03	2017-08-09	AMS5	08:00	24-hr TSP	27	ug/m ³
HKLR	HY/2011/03	2017-08-15	AMS5	08:00	24-hr TSP	17	ug/m ³
HKLR	HY/2011/03	2017-08-21	AMS5	08:00	24-hr TSP	60	ug/m ³
HKLR	HY/2011/03	2017-08-26 (See Remark 3)	AMS5	09:28	24-hr TSP	49	ug/m ³
HKLR	HY/2011/03	2017-08-31	AMS5	08:00	24-hr TSP	47	ug/m ³
HKLR	HY/2011/03	2017-06-01	AMS6	13:00	1-hr TSP	20	ug/m ³
HKLR	HY/2011/03	2017-06-01	AMS6	14:00	1-hr TSP	20	ug/m ³
HKLR	HY/2011/03	2017-06-01	AMS6	15:00	1-hr TSP	28	ug/m ³
HKLR	HY/2011/03	2017-06-07	AMS6	13:05	1-hr TSP	9	ug/m ³
HKLR	HY/2011/03	2017-06-07	AMS6	14:05	1-hr TSP	8	ug/m ³
HKLR	HY/2011/03	2017-06-07	AMS6	15:05	1-hr TSP	10	ug/m ³
HKLR	HY/2011/03	2017-06-13	AMS6	13:00	1-hr TSP	23	ug/m ³
HKLR	HY/2011/03	2017-06-13	AMS6	14:00	1-hr TSP	16	ug/m ³
HKLR	HY/2011/03	2017-06-13	AMS6	15:00	1-hr TSP	14	ug/m ³
HKLR	HY/2011/03	2017-06-19	AMS6	13:01	1-hr TSP	8	ug/m ³
HKLR	HY/2011/03	2017-06-19	AMS6	14:01	1-hr TSP	12	ug/m ³
HKLR	HY/2011/03	2017-06-19	AMS6	15:01	1-hr TSP	24	ug/m ³
HKLR	HY/2011/03	2017-06-23	AMS6	09:00	1-hr TSP	5	ug/m ³
HKLR	HY/2011/03	2017-06-23	AMS6	10:00	1-hr TSP	5	ug/m ³
HKLR	HY/2011/03	2017-06-23	AMS6	11:00	1-hr TSP	4	ug/m ³
HKLR	HY/2011/03	2017-06-29	AMS6	13:20	1-hr TSP	14	ug/m ³
HKLR	HY/2011/03	2017-06-29	AMS6	14:20	1-hr TSP	9	ug/m ³
HKLR	HY/2011/03	2017-06-29	AMS6	15:20	1-hr TSP	5	ug/m ³
HKLR	HY/2011/03	2017-07-03	AMS6	13:00	1-hr TSP	20	ug/m ³
HKLR	HY/2011/03	2017-07-03	AMS6	14:00	1-hr TSP	16	ug/m ³
HKLR	HY/2011/03	2017-07-03	AMS6	15:00	1-hr TSP	19	ug/m ³
HKLR	HY/2011/03	2017-07-07	AMS6	09:00	1-hr TSP	16	ug/m ³
HKLR	HY/2011/03	2017-07-07	AMS6	10:00	1-hr TSP	10	ug/m ³
HKLR	HY/2011/03	2017-07-07	AMS6	11:00	1-hr TSP	10	ug/m ³
HKLR	HY/2011/03	2017-07-13	AMS6	13:00	1-hr TSP	5	ug/m ³
HKLR	HY/2011/03	2017-07-13	AMS6	14:00	1-hr TSP	4	ug/m ³
HKLR	HY/2011/03	2017-07-13	AMS6	15:00	1-hr TSP	2	ug/m ³
HKLR	HY/2011/03	2017-07-19	AMS6	13:03	1-hr TSP	11	ug/m ³
HKLR	HY/2011/03	2017-07-19	AMS6	14:03	1-hr TSP	13	ug/m ³
HKLR	HY/2011/03	2017-07-19	AMS6	15:03	1-hr TSP	8	ug/m ³
HKLR	HY/2011/03	2017-07-25	AMS6	13:05	1-hr TSP	5	ug/m ³
HKLR	HY/2011/03	2017-07-25	AMS6	14:05	1-hr TSP	5	ug/m ³
HKLR	HY/2011/03	2017-07-25	AMS6	15:05	1-hr TSP	7	ug/m ³
HKLR	HY/2011/03	2017-07-31	AMS6	13:00	1-hr TSP	93	ug/m ³
HKLR	HY/2011/03	2017-07-31	AMS6	14:00	1-hr TSP	83	ug/m ³
HKLR	HY/2011/03	2017-07-31	AMS6	15:00	1-hr TSP	72	ug/m ³
HKLR	HY/2011/03	2017-08-04	AMS6	08:50	1-hr TSP	13	ug/m ³
HKLR	HY/2011/03	2017-08-04	AMS6	09:50	1-hr TSP	19	ug/m ³
HKLR	HY/2011/03	2017-08-04	AMS6	10:50	1-hr TSP	21	ug/m ³


Air Quality Monitoring Data

HKLR	HY/2011/03	2017-08-10	AMS6	13:00	1-hr TSP	32	ug/m ³
HKLR	HY/2011/03	2017-08-10	AMS6	14:00	1-hr TSP	25	ug/m ³
HKLR	HY/2011/03	2017-08-10	AMS6	15:00	1-hr TSP	24	ug/m ³
HKLR	HY/2011/03	2017-08-16	AMS6	13:00	1-hr TSP	15	ug/m ³
HKLR	HY/2011/03	2017-08-16	AMS6	14:00	1-hr TSP	13	ug/m ³
HKLR	HY/2011/03	2017-08-16	AMS6	15:00	1-hr TSP	13	ug/m ³
HKLR	HY/2011/03	2017-08-22	AMS6	13:00	1-hr TSP	142	ug/m ³
HKLR	HY/2011/03	2017-08-22	AMS6	14:00	1-hr TSP	114	ug/m ³
HKLR	HY/2011/03	2017-08-22	AMS6	15:00	1-hr TSP	92	ug/m ³
HKLR	HY/2011/03	2017-08-28	AMS6	09:00	1-hr TSP	11	ug/m ³
HKLR	HY/2011/03	2017-08-28	AMS6	10:00	1-hr TSP	12	ug/m ³
HKLR	HY/2011/03	2017-08-28	AMS6	11:00	1-hr TSP	25	ug/m ³
HKLR	HY/2011/03	2017-06-06	AMS6	08:00	24-hr TSP	60	ug/m ³
HKLR	HY/2011/03	2017-06-12	AMS6	08:00	24-hr TSP	95	ug/m ³
HKLR	HY/2011/03	2017-06-17	AMS6	08:00	24-hr TSP	23	ug/m ³
HKLR	HY/2011/03	2017-06-22	AMS6	08:00	24-hr TSP	26	ug/m ³
HKLR	HY/2011/03	2017-06-28	AMS6	08:00	24-hr TSP	35	ug/m ³
HKLR	HY/2011/03	2017-07-04	AMS6	08:00	24-hr TSP	27	ug/m ³
HKLR	HY/2011/03	2017-07-06	AMS6	08:00	24-hr TSP	31	ug/m ³
HKLR	HY/2011/03	2017-07-12	AMS6	08:00	24-hr TSP	53	ug/m ³
HKLR	HY/2011/03	2017-07-18	AMS6	08:00	24-hr TSP	23	ug/m ³
HKLR	HY/2011/03	2017-07-24	AMS6	08:00	24-hr TSP	33	ug/m ³
HKLR	HY/2011/03	2017-07-28	AMS6	08:00	24-hr TSP	118	ug/m ³
HKLR	HY/2011/03	2017-08-03	AMS6	08:00	24-hr TSP	33	ug/m ³
HKLR	HY/2011/03	2017-08-09	AMS6	08:00	24-hr TSP	43	ug/m ³
HKLR	HY/2011/03	2017-08-15	AMS6	08:00	24-hr TSP	51	ug/m ³
HKLR	HY/2011/03	2017-08-21	AMS6	08:00	24-hr TSP	105	ug/m ³
HKLR	HY/2011/03	2017-08-25	AMS6	08:00	24-hr TSP	35	ug/m ³
HKLR	HY/2011/03	2017-08-31	AMS6	08:00	24-hr TSP	63	ug/m ³

Remarks:

- 1) Due to power supply failure, the 24-hour TSP monitoring at AMS5 was rescheduled from 28 June 2017 to 29 June 2017.
- 2) Due to motor failure, the 24-hour TSP monitoring at AMS5 was rescheduled from 24 July 2017 to 26 July 2017.
- 3) The 24-hour TSP monitoring at AMS5 was rescheduled from 25 August 2017 to 26 August 2017 due to power outage of Ma Wan Chung Village caused by seawater engulfment.

Graphical Plot of 1-hour TSP at AMS5 and AMS6

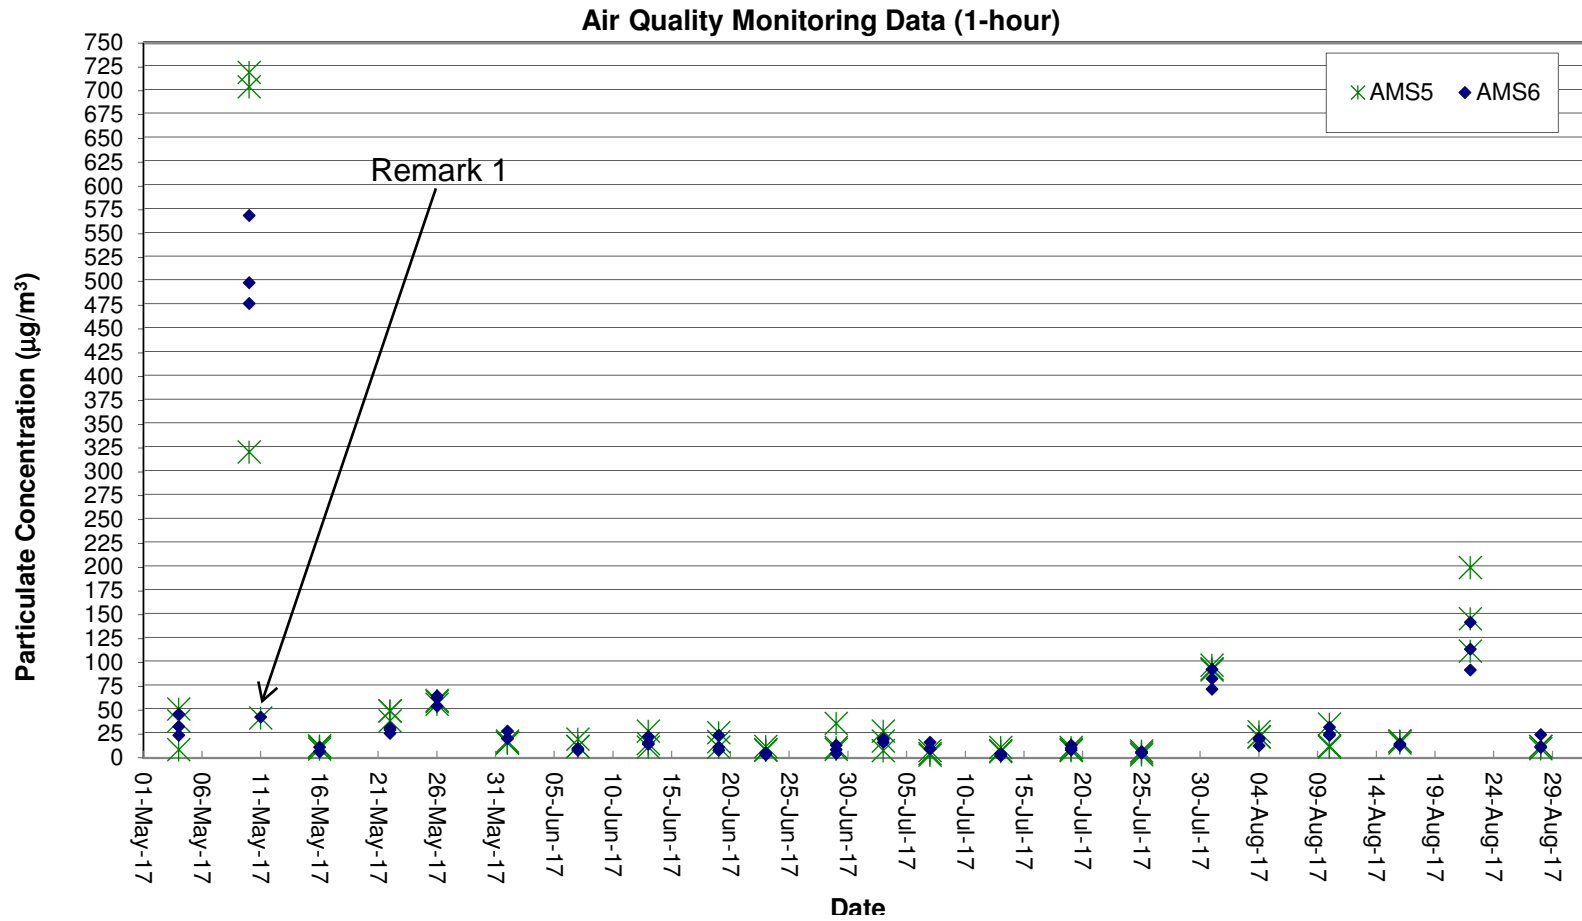


Remark:

1) Due to the Action/Limit level exceedances of 1-hr TSP were recorded at AMS5 and AMS6 on 10 May 2017, an additional 1-hr TSP monitoring was conducted on 11 May 2017 at AMS5 and AMS6 respectively.

Graphical Plot of 24-hour TSP at AMS5 and AMS6

Air Quality Monitoring Data (24-hour)

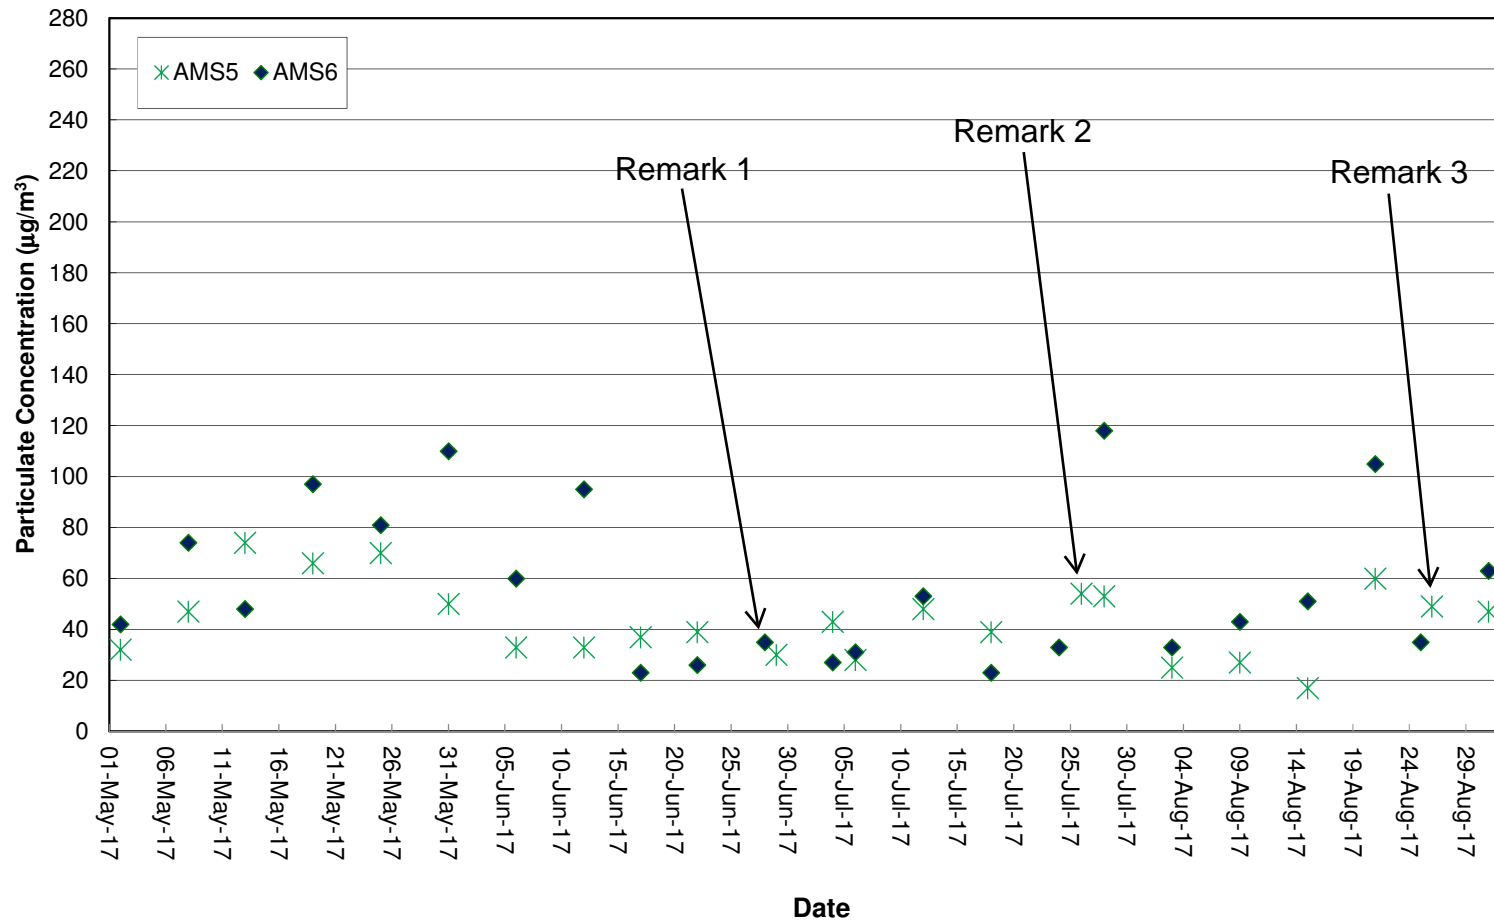

Remarks:

- 1) Due to power supply failure, the 24-hour TSP monitoring at AMS5 was rescheduled from 28 June 2017 to 29 June 2017.
- 2) Due to motor failure, the 24-hour TSP monitoring at AMS5 was rescheduled from 24 July 2017 to 26 July 2017.
- 3) The 24-hour TSP monitoring at AMS5 was rescheduled from 25 August 2017 to 26 August 2017 due to power outage of Ma Wan Chung Village caused by seawater engulfment.